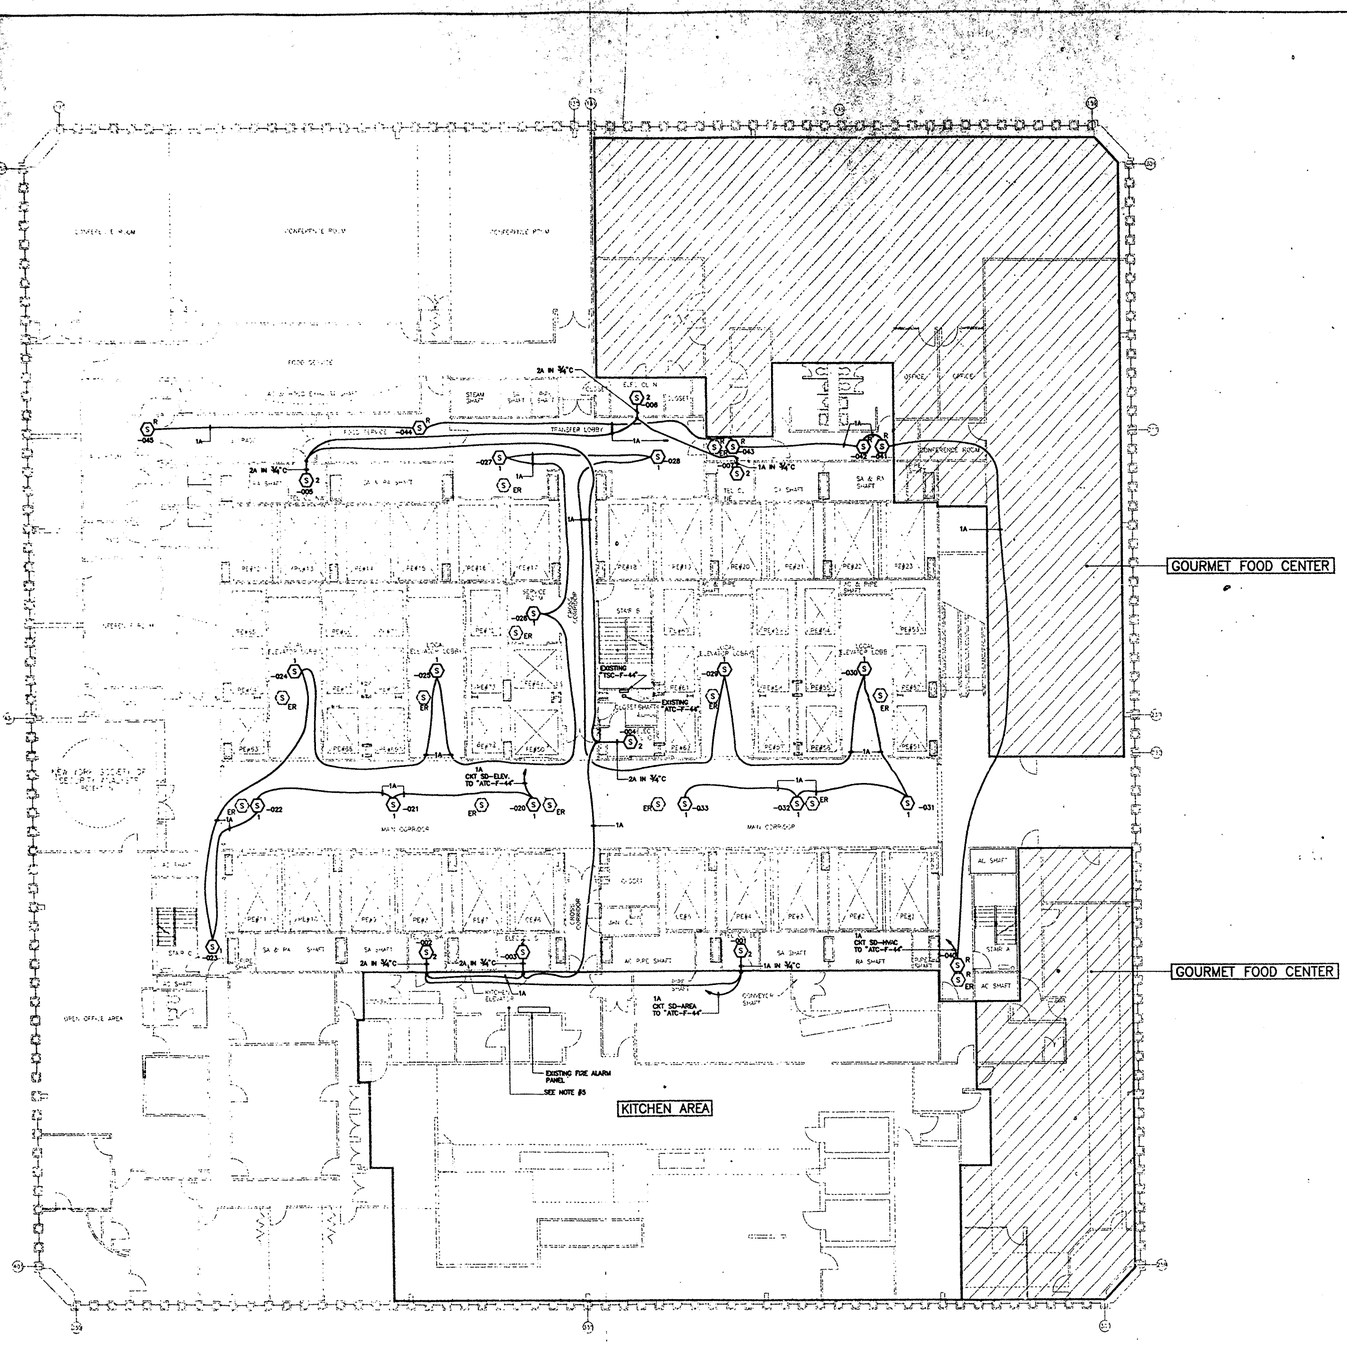


SMOKE DETECTOR PLAN

NOTES:

1. FOR GENERAL NOTES, LEGEND, RISERS, SEE DRAWING F-1-2-1.
2. ALL ADDRESSABLE SMOKE DETECTORS CIRCUITS SHALL BE RUN TO EXISTING ATC CABINET.
3. THE CONTRACTOR SHALL DISCONNECT AND REMOVE THE OLD (EXISTING) SMOKE DETECTORS SHOWN TO BE REMOVED ONLY AFTER THE INSTALLED DEVICES ARE OPERATIONAL AS DIRECTED AND IN THE PRESENCE OF THE ENGINEER.
4. REFER TO THE MECHANICAL DRAWING M-1 FOR THE REQUIREMENTS AND THE LOCATIONS OF THE PLENUM SMOKE DETECTORS.
5. CONTRACTOR TO PROVIDE TRI MODULE FOR TROUBLE SIGNAL FOR THE EXISTING TENANT FIRE ALARM CONTROL PANEL TO REMAIN.
6. CONTRACTOR SHALL FIELD VERIFY THE EXISTENCE OF ANY RETURN AIR DUCTS AND REFER TO DRAWING M-1 FOR WORK REQUIRED.
7. CONTRACTOR SHALL LOCATE ALL SMOKE DETECTORS PER BUILDING CODE.

Sheet Of

THE PORT AUTHORITY OF NY & NJ

Joseph R. Loring & Associates, Inc.
consulting engineers
One Pennsylvania Plaza
New York, New York 10119-0045
Tel: (212) 563-7400
Fax: (212) 563-7382


SCR Design Organization, Inc.
architects
305 EAST 46 STREET
NEW YORK, N.Y. 10017
TEL: (212) 421-3500

No.	Date	Revision	Approved
1	6/24/98	AS BID	DC

Engineering Department
Design Division
The World Trade Center

Title

TOWER 1
FLOOR 44
FIRE ALARM
SMOKE DETECTOR
INSTALLATION AND
REMOVAL PLAN



KEY PLAN

This drawing subject to conditions in contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

F.D.	F.D.	4565.000
Designed by	Drawn by	JRLA JOB No.
4/27/98	P.E.N	3/32"=1'-0"
Date	Checked by	Scale

Contract Number: WTC-857.090

Drawing Number: F-1-44-2

W:\WORK\CAD\CONTRACT\F-1-44-2.dwg 10/28/1998 14:08 Last modified by Holland